


## EV-MCP2-SCI-IP24 Installation instructions


1. For Surface Mounting, carefully cut/drill holes for cables/glands, in the Back Box, if required for the installation. Fix the Back Box to wall using screws provided, through the pre-drilled holes.

For Flush Mounting, Fix the Wall Plate to wall using screws provided.

**NOTE:** For Flush Mounting use 35mm Metal Knockout box or Dry lining box.



Surface Mount Back Box



Flush Mount Wall Plate

3. Set the device address using the 8-Way DIL switch on the reverse of the Unit.

4. Make the Loop connections as shown in figure 1 below, using the mating connectors provided. **NOTE:** Loop end plugs can be connected together for initial cable testing.

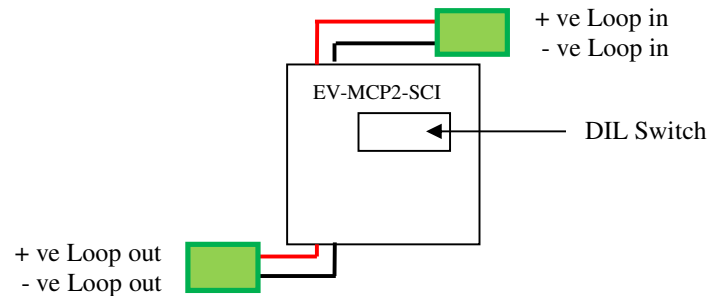


Figure 1

5. Clip the Reset Lid to the Back Box, ensuring the clip is full engaged.

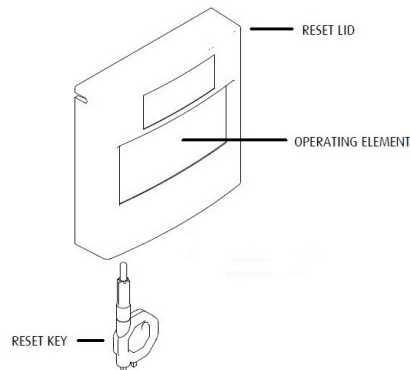


Figure 2

## EV-MCP2-SCI-IP24 Installation instructions

6. To Activate the Call Point, Press the Operating Face, where indicated by the arrows, until it Clicks and the Yellow/Black flag is clearly visible.

7. To Reset the Call Point, Insert the Reset Key where shown in Figure 2 and turn anti-clockwise until it Clicks and the Yellow/Black flag has retracted from view.

EV-MCP2-SCI-IP24 - Resettable Manual Call Point  
with integral Short Circuit Isolator.



**NITTAN**

Nittan Europe Ltd. Tel: +44 (0) 1483 769 555  
Hiple Street, Fax: +44 (0) 1483 756 686  
Old Woking, Email: [sales@nittan.co.uk](mailto:sales@nittan.co.uk)  
Surrey, GU22 9LQ Web: [www.nittan.co.uk](http://www.nittan.co.uk)  
United Kingdom

D.o.P. Number: 00440

EN54-11: 2011 - Type A Indoor Manual Call Point IP24  
EN54-17: 2005 - Short Circuit Isolator

For use with Nittan Evolution Protocol Only.  
Loop Voltage: 20 to 38 V d.c.  
Quiescent Current: 200µA  
Alarm Current: 2mA (LED ON).

Technical Data Sheet: TD-EV-MCP2-SCI-IP24